


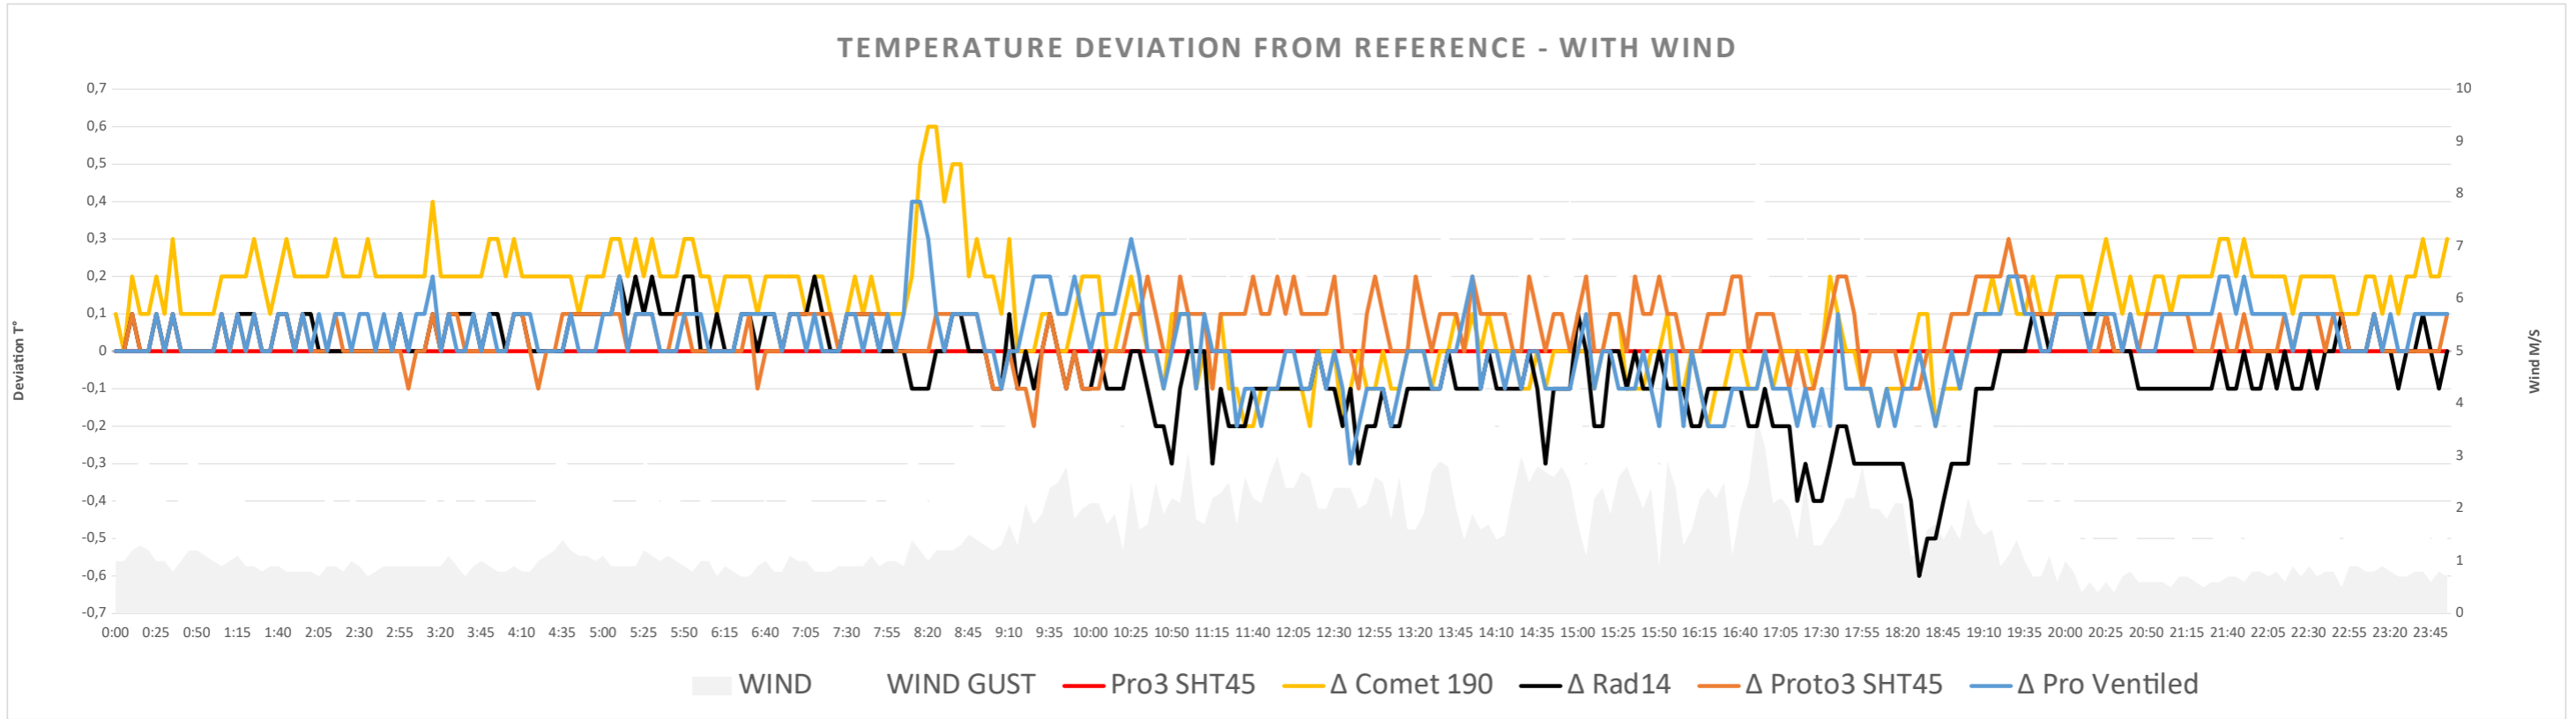


Temperature & Deviation

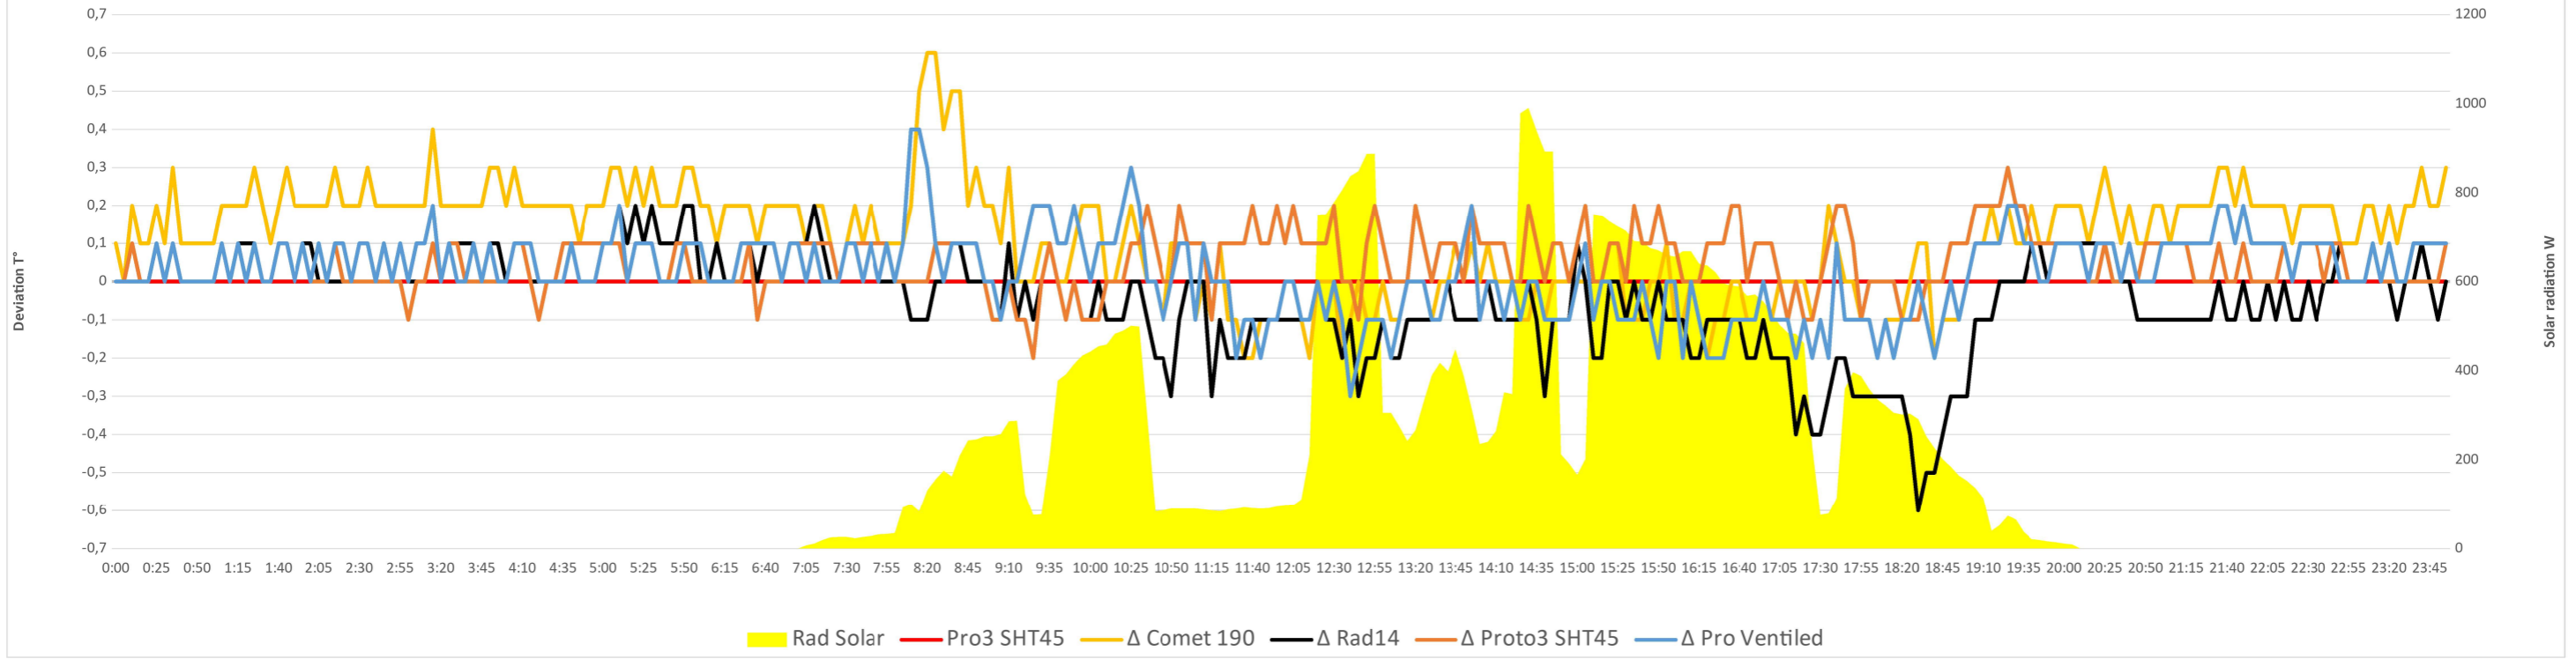

Temperature deviation from reference - with solar radiation

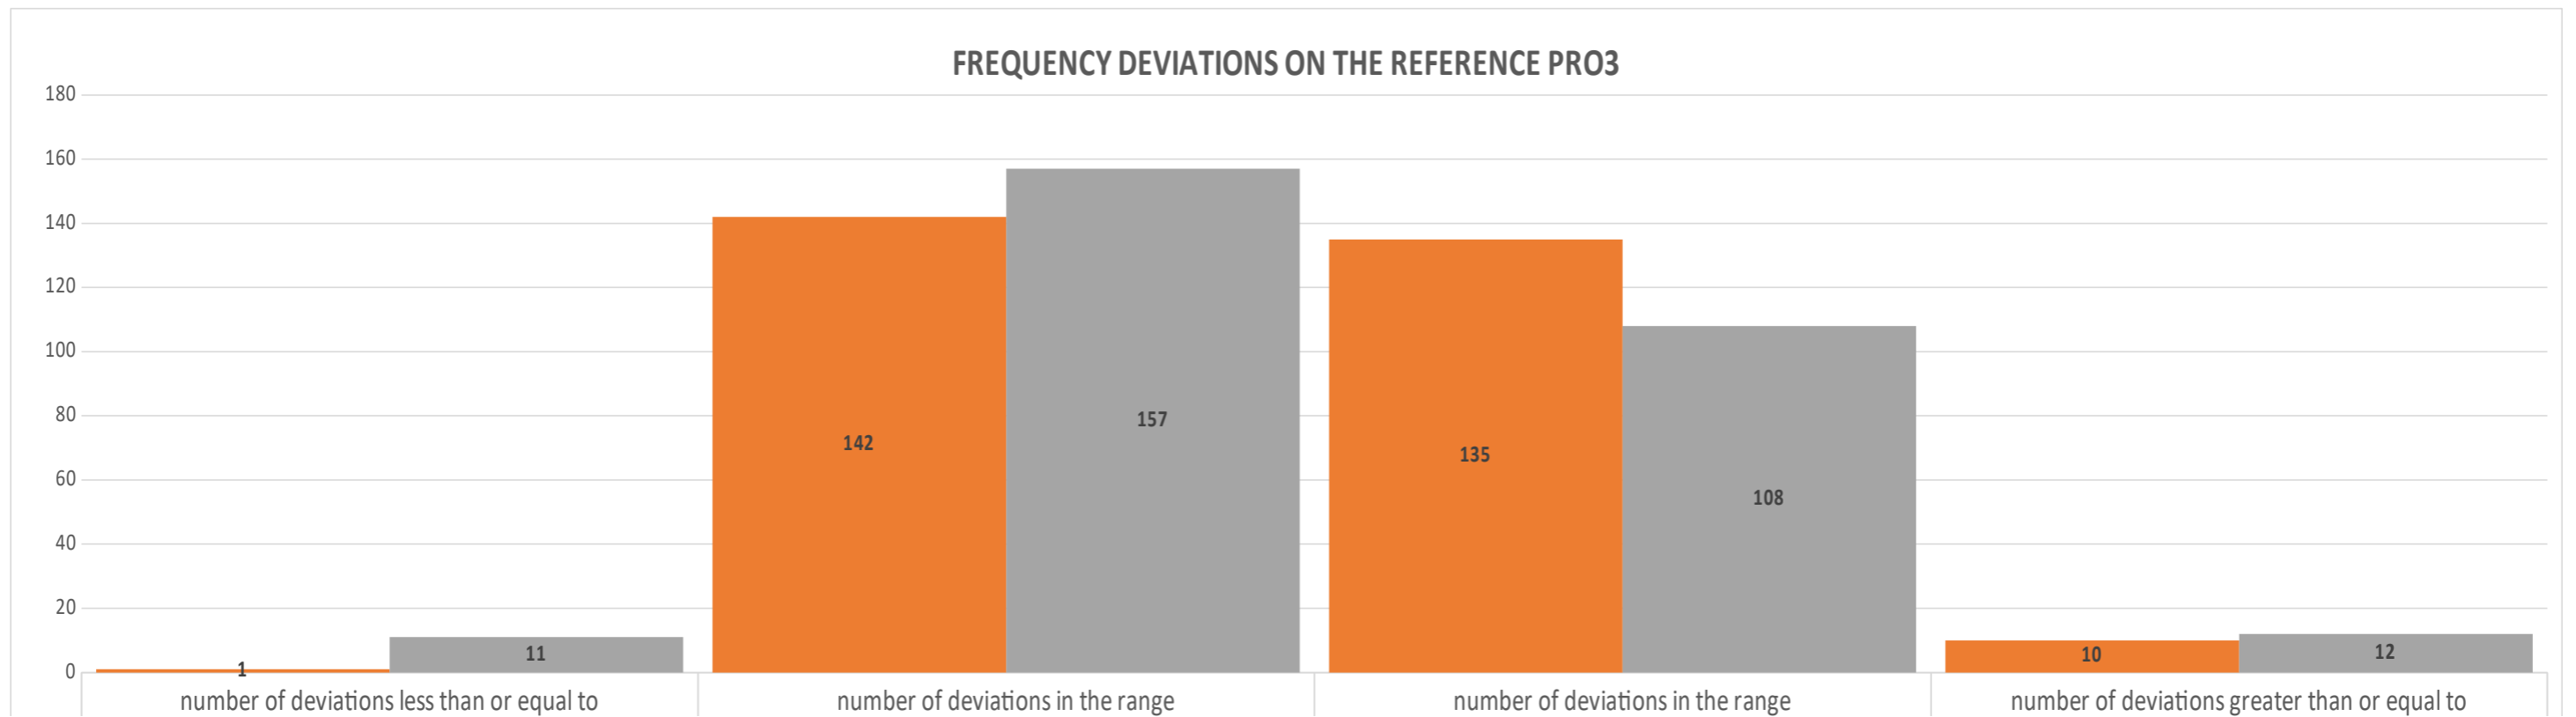

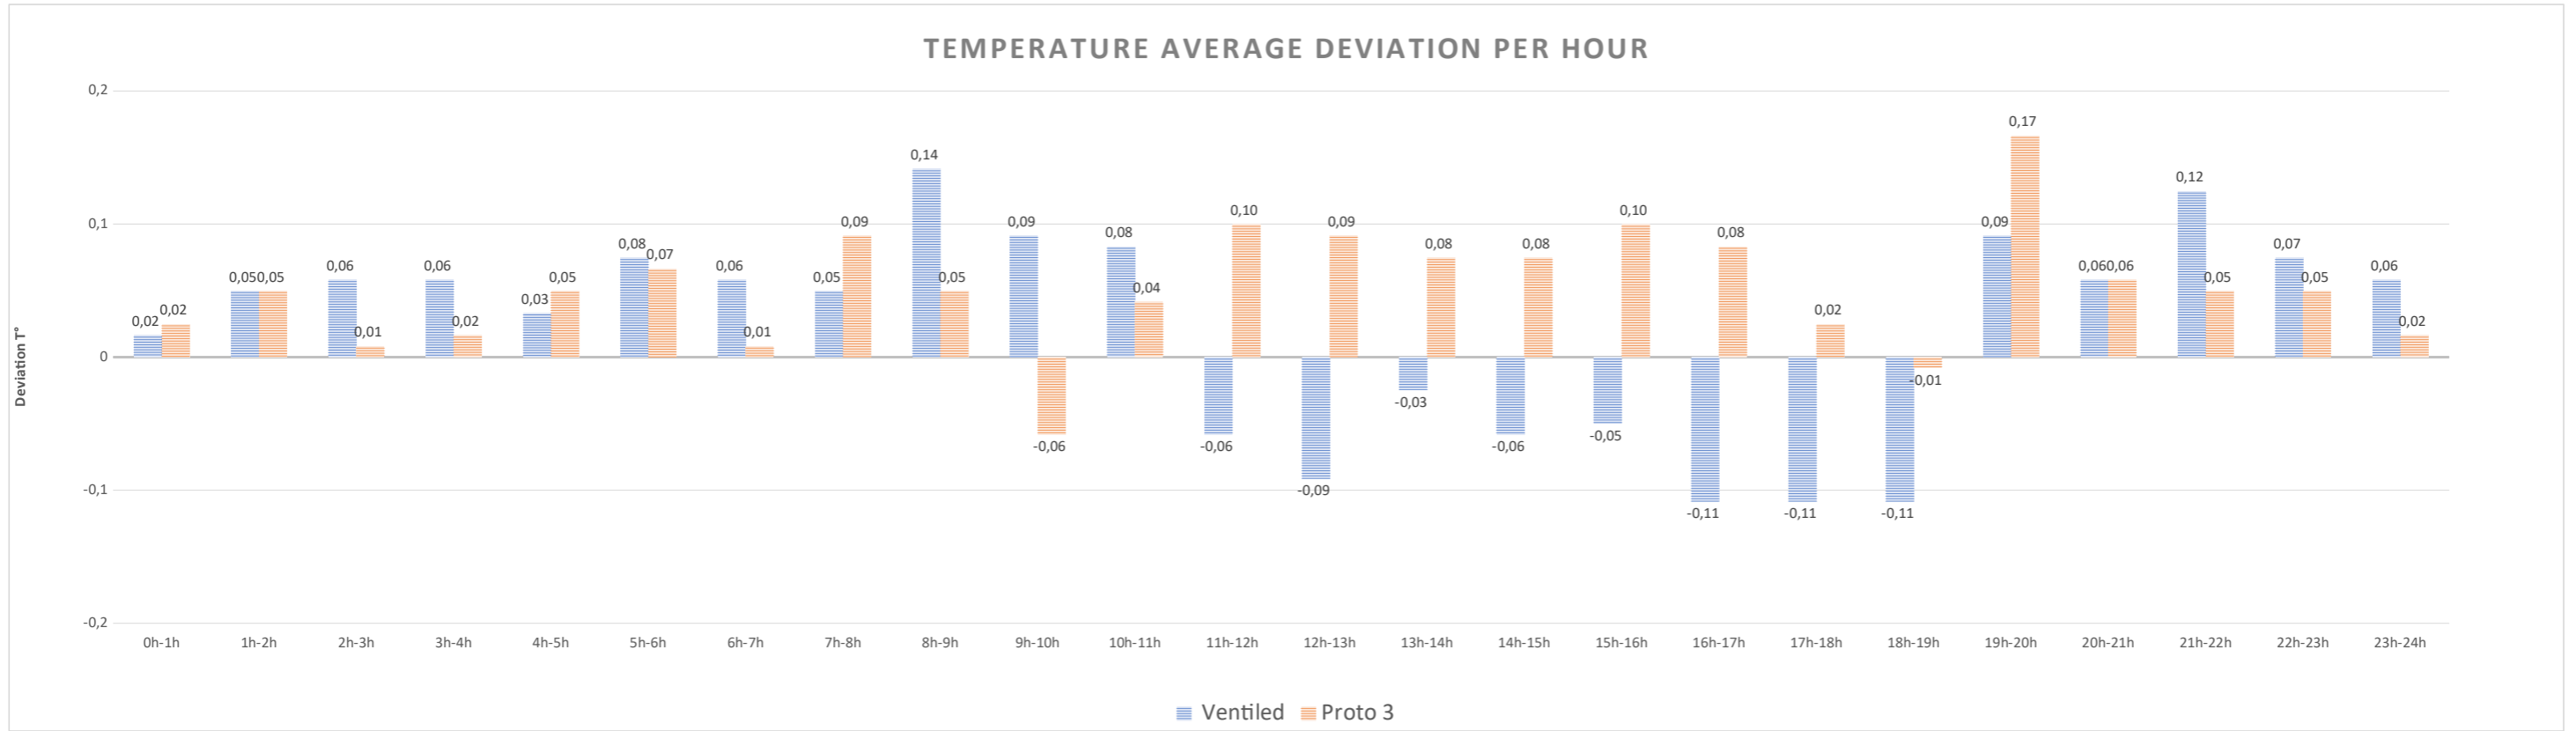

-0,20


0,00
-0,10

0,20
0,10


0,20

■ Proto 3 ■ Ventiled


FREQUENCY DEVIATIONS ON THE REFERENCE PRO3

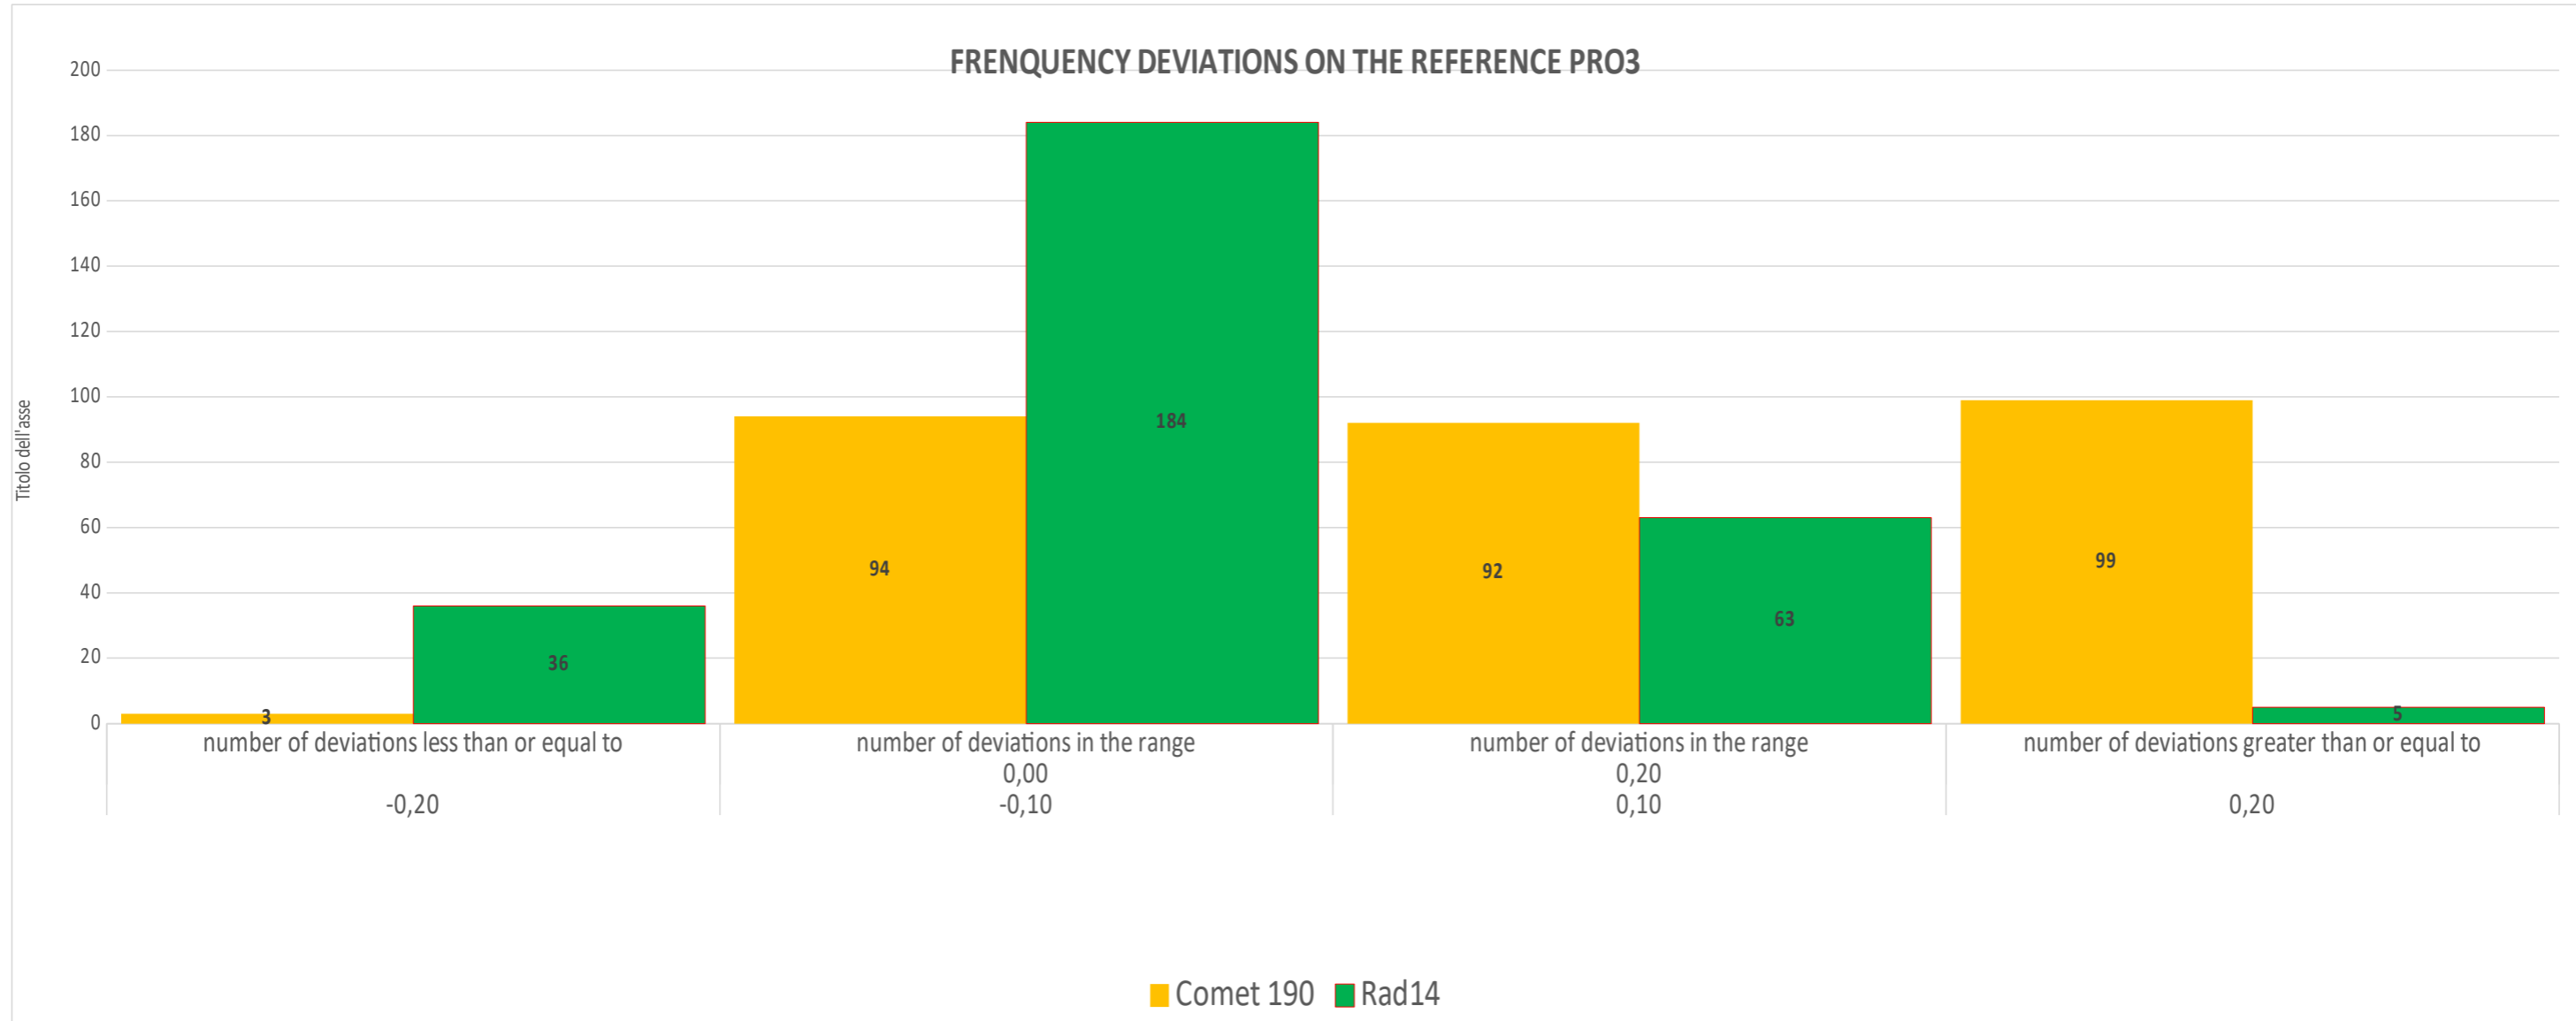


TEMPERATURE DEVIATION AND PRESSURE

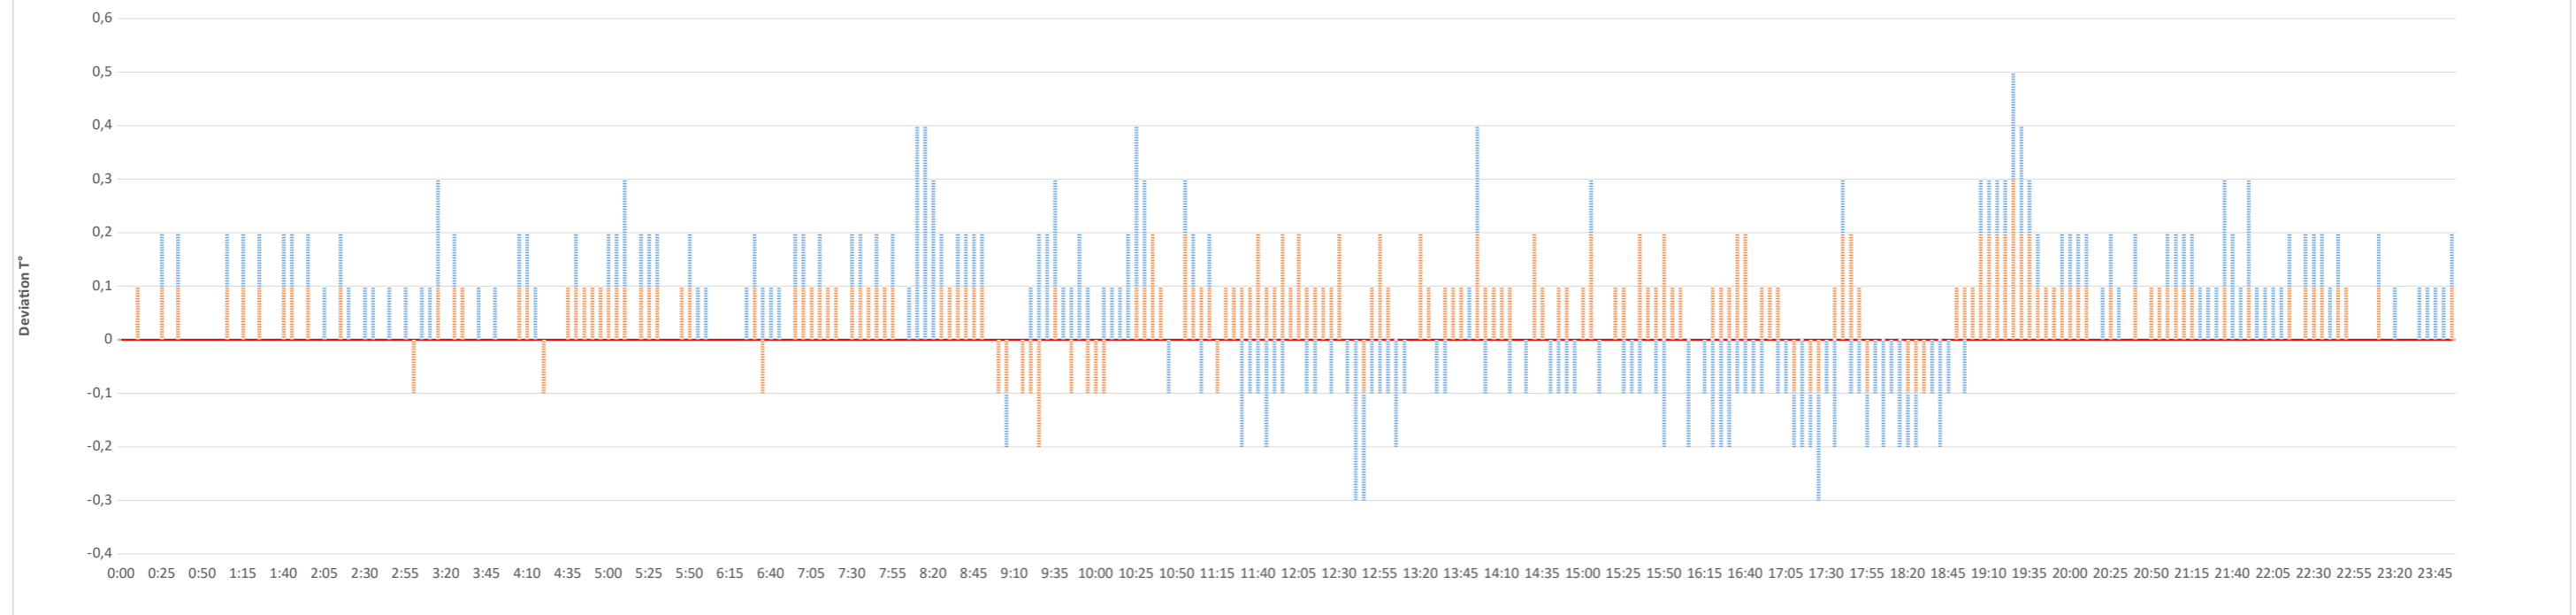

 Pro3 SHT45

 Δ Proto3 SHT45

 Δ Pro Ventiled